



**PLAN VIEW - PARALLEL INSTALLATION**

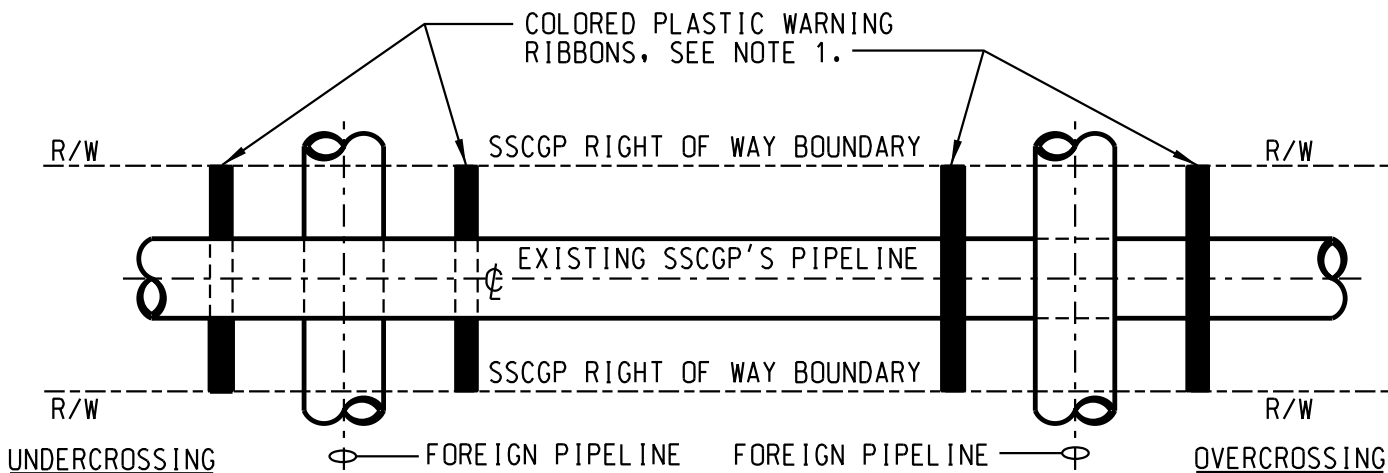

**PLAN VIEW - CROSSING INSTALLATION**

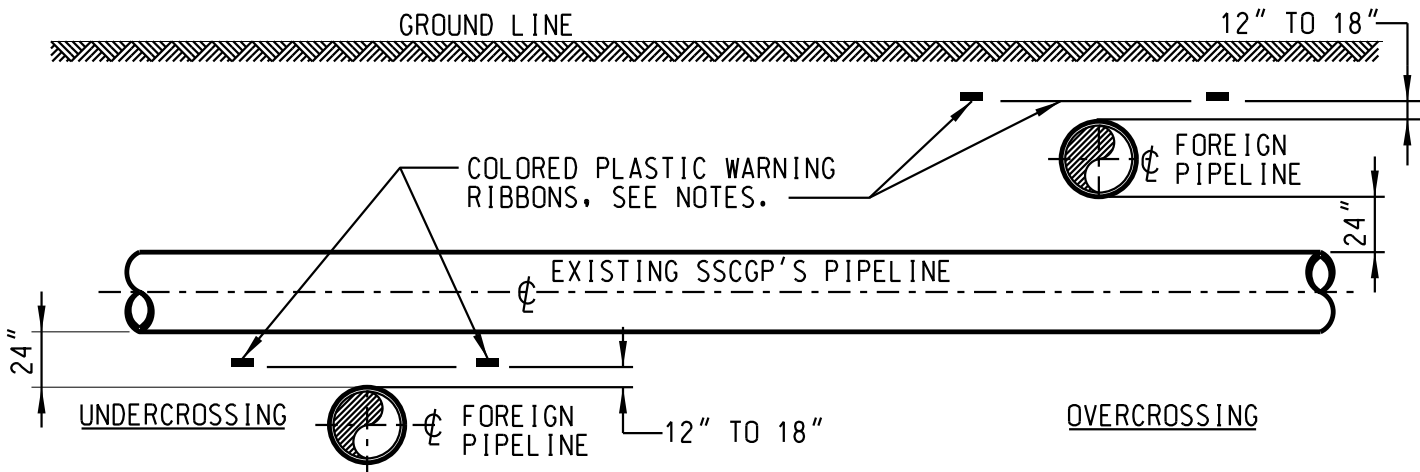

**ELEVATION - CROSSING INSTALLATION**

**NOTES:**

DURING BACKFILL OPERATIONS, A COLORED PLASTIC RIBBON SHALL BE LAID 12" TO 18" ABOVE THE FOREIGN PIPELINE IN BOTH SIDES OF THE DITCH THE ENTIRE WIDTH OF SSCGP'S RIGHT OF WAY. HYDROCARBON, GAS OR LIQUID LINES ARE TO BE MARKED WITH SAFETY YELLOW, WATER, IRRIGATION OR SLURRY LINES WITH SAFETY BLUE, AND SEWERS AND DRAIN LINES WITH SAFETY GREEN.



STANDARD ENCROACHMENT DETAILS  
FOR INSTALLATION OF FOREIGN PIPELINE PARALLEL  
TO OR CROSSING EXISTING SSCGP GAS PIPELINE

REV.	DATE	BY	DESCRIPTION	APP	SCALE: 1" = 1'-0"
0	05-05-2004	GLS	REVISED PER SSCGP STANDARDS	RDH	P. I. N.
1	11-05-2007	DSK	REPLACED STD. DWG. 005-079-A-0153	RDH	DWG. NO. STD-ENC-PX-FP

DRAWN BY: GLS	DATE: 05-04-2004
CHECKED BY:	DATE:
APPROVED BY: RDH	DATE: 05-28-2004