


**PLAN VIEW**

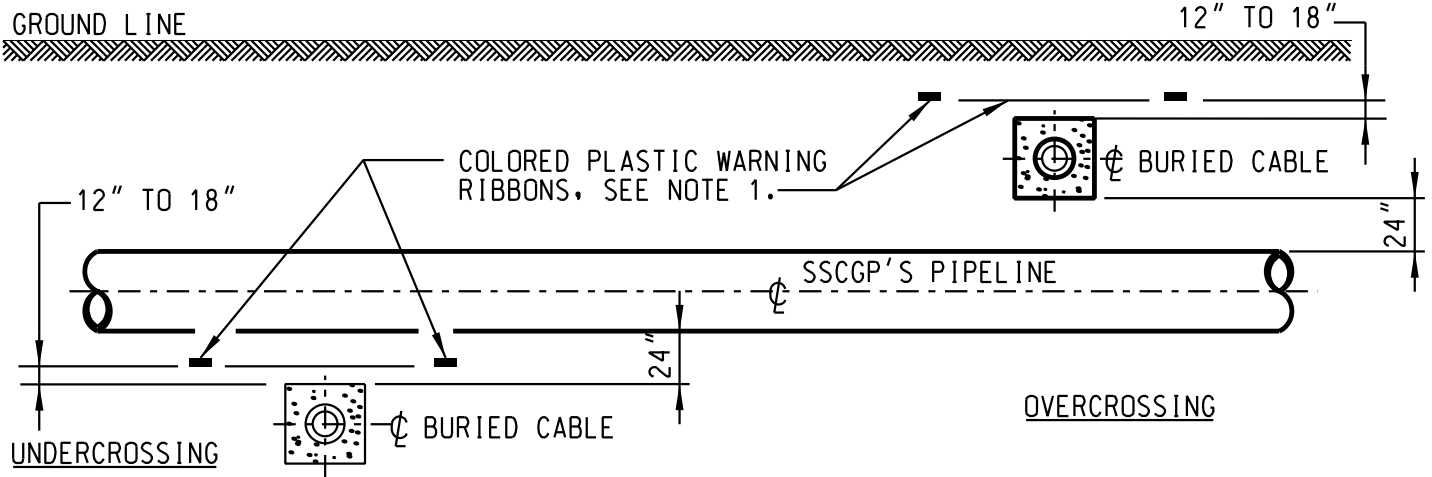

**ELEVATION - CROSSING INSTALLATION** 2

**NOTES:**

1. DURING BACKFILL OPERATIONS, A SAFETY RED PLASTIC RIBBON SHALL BE LAID 12" TO 18" ABOVE THE UNDERGROUND CABLE IN BOTH SIDES OF THE DITCH THE ENTIRE WIDTH OF SSCGP'S RIGHT OF WAY.
2. ABOVE GROUND ELECTRICAL OR FIBER OPTIC LOCATION MARKER WILL BE INSTALLED AT EACH END OF RED CONCRETE.
3. ALL FOREIGN LINES TO BE ENCASED IN SCH. 40 STEEL (MINIMUM) OR SCH. 80 PLASTIC (MINIMUM) PIPE.



STANDARD ENCROACHMENT DETAILS  
FOR INSTALLATION OF ELECTRICAL OR FIBER OPTIC CABLE  
CROSSING SSCGP'S PIPELINE

REV.	DATE	BY	DESCRIPTION	APP	SCALE: 1" = 1'-0"
0	05-14-2004	GLS	COMBINED 005-090-0068 AND 0069	RDH	P. I. N.
1	11-05-2007	JAK	REPLACES STD. DWG. 005-090-A-0143	RDH	DWG. NO.
2	09-04-1014	MDR	ADDED NOTE 3		STD-ENC-X-EC

DRAWN BY:	GLS	DATE:	05-04-2004
CHECKED BY:		DATE:	
APPROVED BY:	RDH	DATE:	05-28-2004